
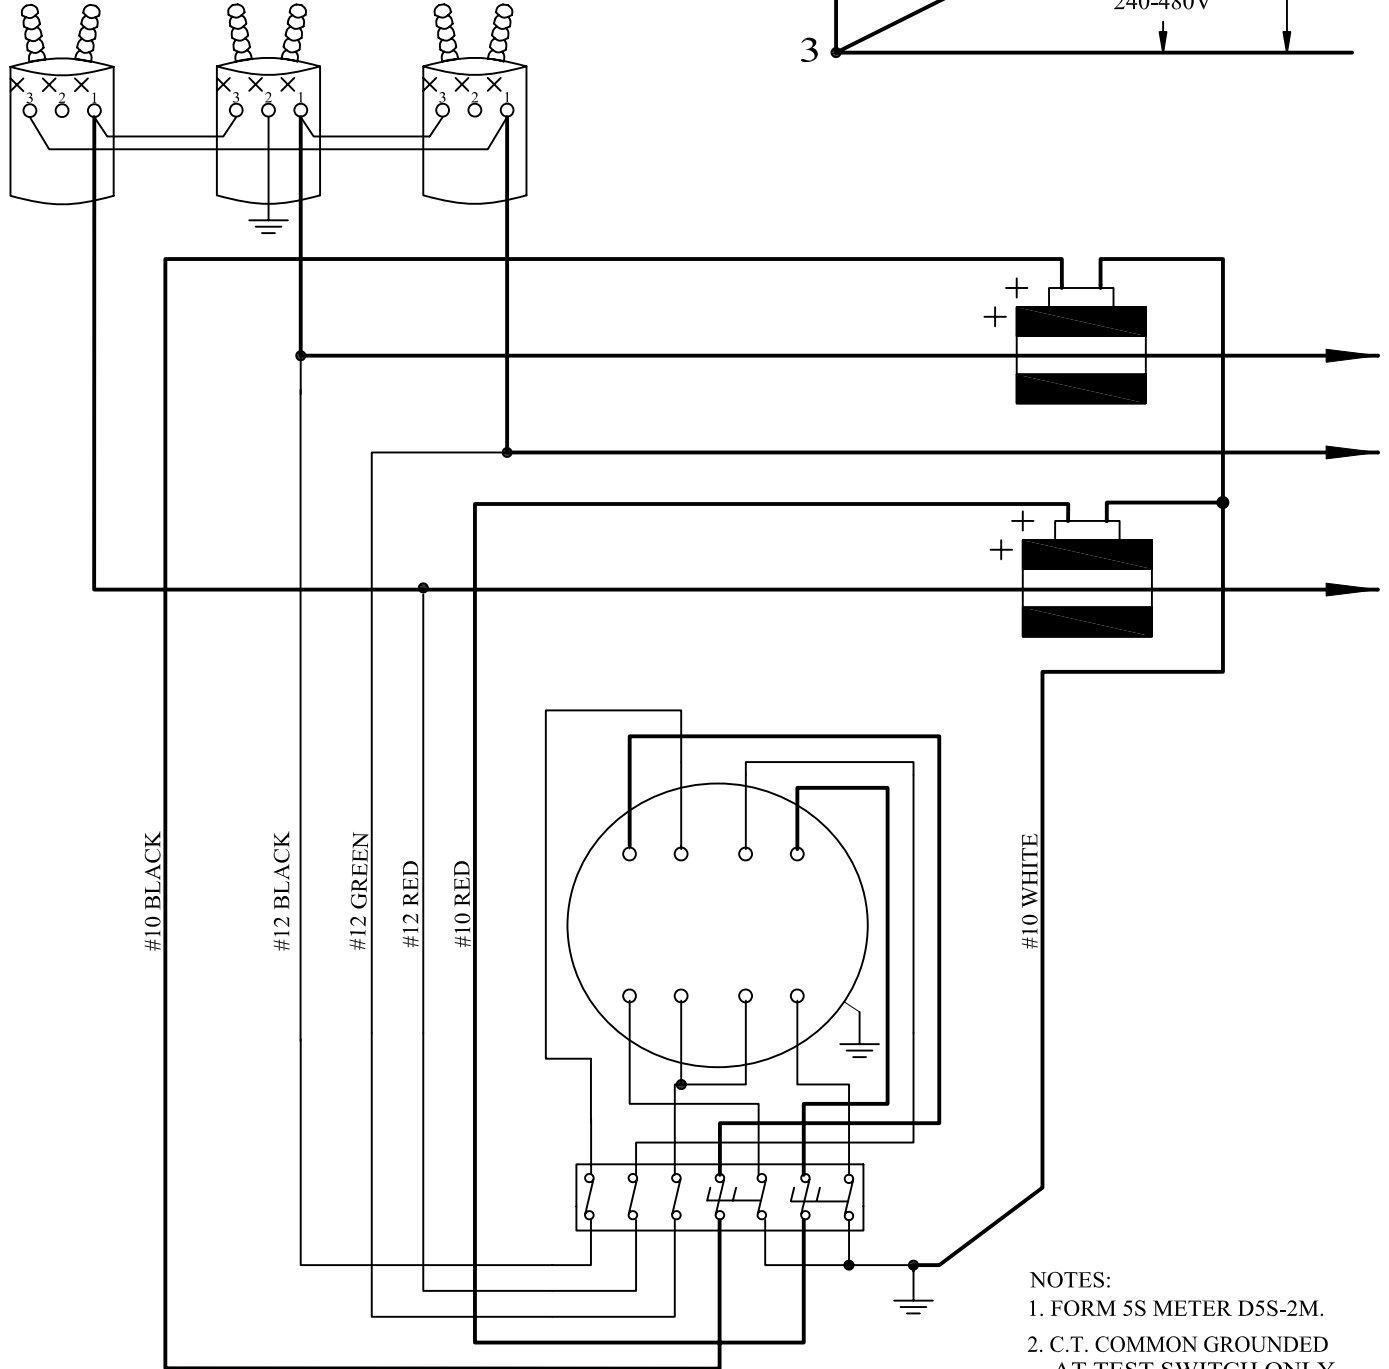


POLYPHASE - TRANSFORMER - RATED

MEASUREMENT OF ENERGY ON A THREE-PHASE,
THREE-WIRE DELTA SERVICE WITH 2 CT'S AND A
2 STATER METER.

(NO LINE TO NEUTRAL LOAD)

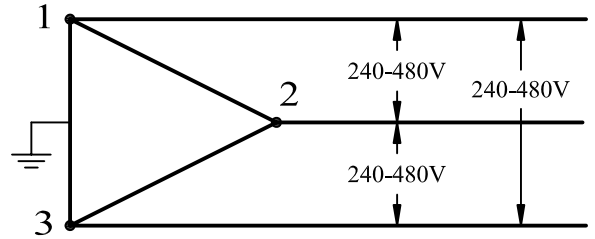

- NOTES:
1. FORM 5S METER D5S-2M.
 2. C.T. COMMON GROUNDED AT TEST SWITCH ONLY.
 3. REGISTER MULTIPLIER EQUALS C.T. RATIO.

TEST SWITCH, 7 POLE
MILBANK CATALOG #TS07-0105
OR APPROVED EQUIVALENT

METER BASE, 8 JAW
MILBANK CATALOG #UC3438-XL
OR APPROVED EQUIVALENT

BIG BEND ELECTRIC COOP, INC.
RITZVILLE, WA

Drawn By: M. R. B.
Approved By: D. R. B.

Date: 4 / 17 / 98 Rev: 4 / 14 / 04
Date: 4 / 14 / 04