



METER POLE SERVICE - 3 PHASE, 3 WIRE

240/480 VOLTS - C.T. METERING (NO LINE - TO - NEUTRAL LOAD)

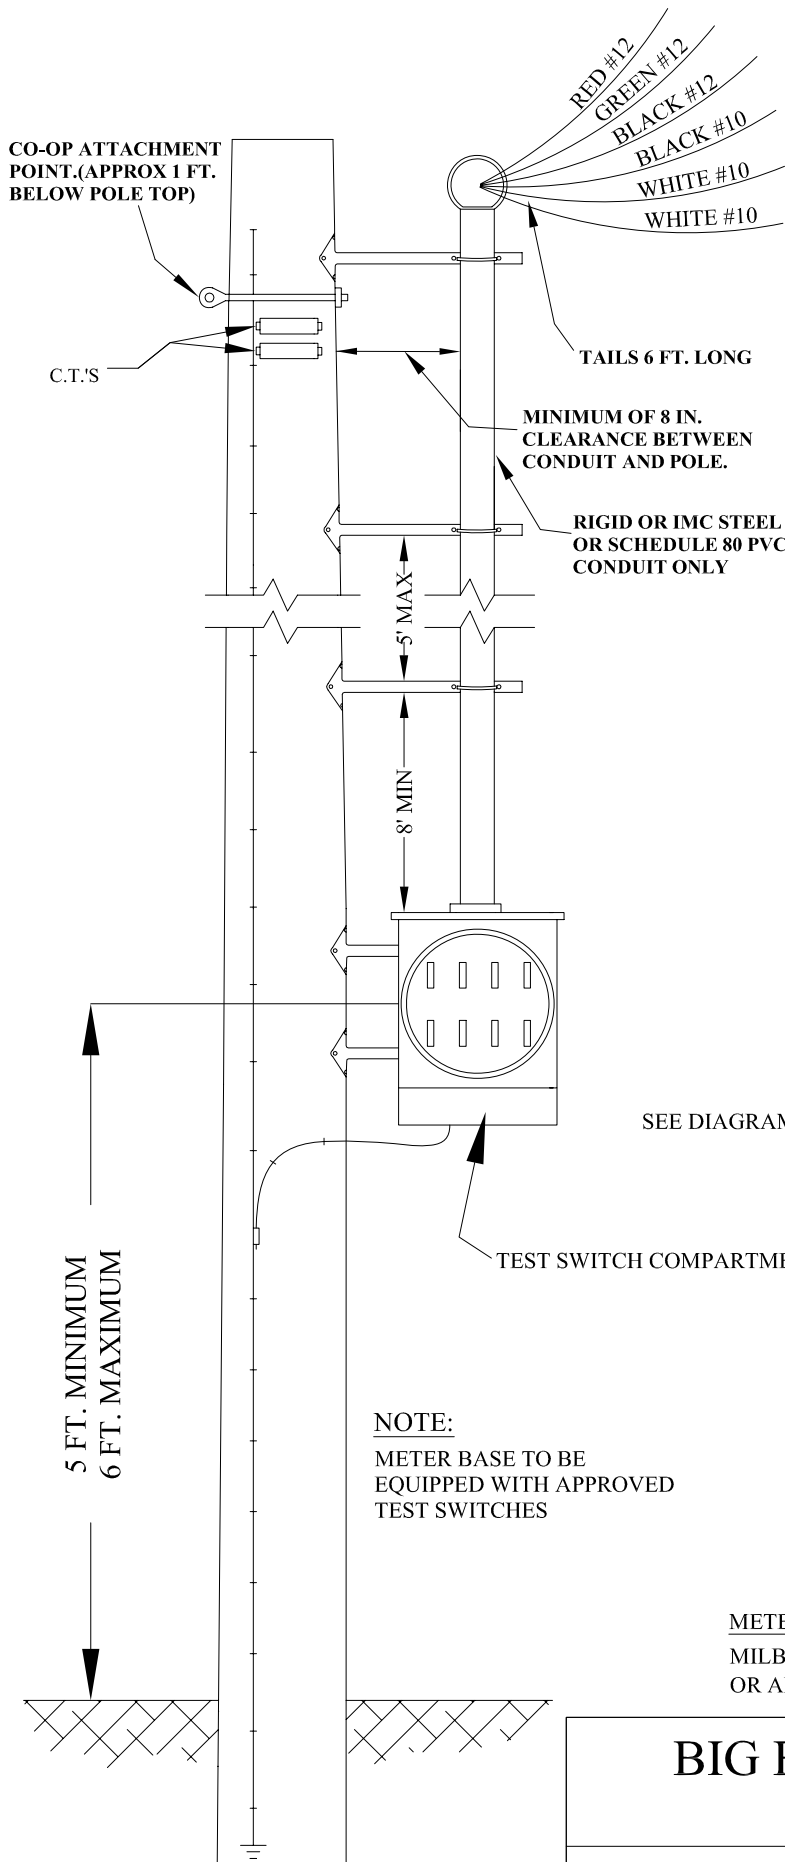

- NOTES:**
- POLE, SERVICE TO POLE, METER, AND GROUND WIRE AND CURRENT TRANSFORMERS FURNISHED BY B.B.E.C.
 - C.T. METERING TO BE USED FOR 151 HP AND UP OR EQUIVALENT LOADS.
 - ALL CONDUITS AND METERING TO BE MOUNTED ON STAND-OFF BRACKETS A MINIMUM OF 8 IN. FROM POLE.
 - CONDUIT LENGTH AS REQUIRED TO PLACE WEATHER HEAD BETWEEN CO-OP ATTACHMENT POINT AND POLE TOP. TYPICAL LENGTHS:
 14 FT. FOR 25 FT. POLE
 18.5 FT. FOR 30 FT. POLE
 23 FT. FOR 35 FT. POLE
 - CONDUIT SHALL BE RIGID OR IMC STEEL OR SCHEDULE 80 PVC ONLY.
 - DEPENDENT ON YOUR SERVICE INSTALLATION, A MAIN BREAKER MAY BE REQUIRED. CONTACT AN ELECTRICIAN OR STATE L & I PRIOR TO INSTALLING YOUR METERING EQUIPMENT.
 - METER BASE TO BE C.T. RATED AND EQUIPPED WITH TEST SWITCHES.

WIRING DIAGRAM

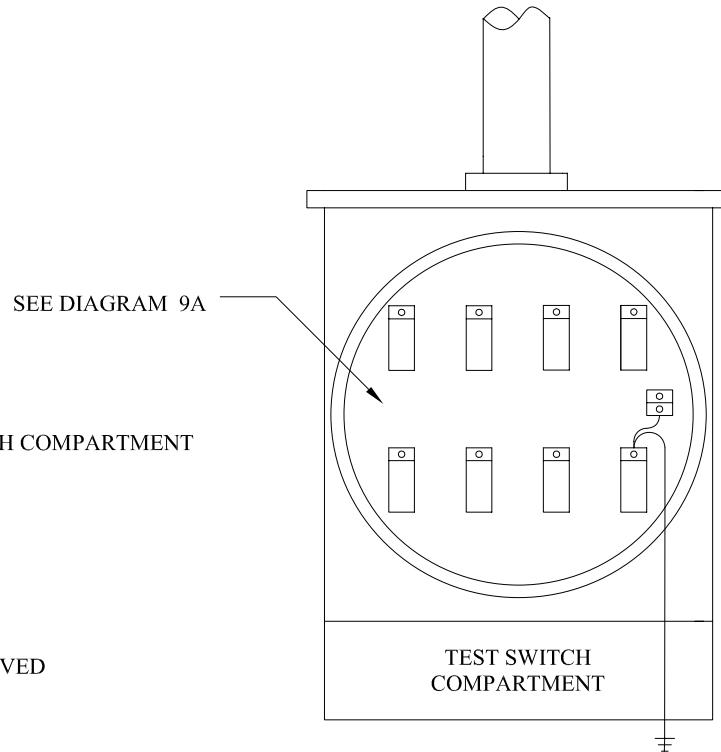

NOTE:
METER BASE TO BE EQUIPPED WITH APPROVED TEST SWITCHES

METER BASE, 8 JAW
MILBANK CATALOG #UC3438-XL
OR APPROVED EQUIVALENT

TEST SWITCH, 7 POLE
MILBANK CATALOG #TS07-0105
OR APPROVED EQUIVALENT

BIG BEND ELECTRIC COOP, INC.
RITZVILLE, WA

DIAGRAM F

Drawn By:	J.R.L.	Date:	3/24/09
Approved By:	C.A.C.	Date:	4/27/09