



METER POLE SERVICE - 3 PHASE, 4 WIRE WYE

120/208 - C.T. METERING

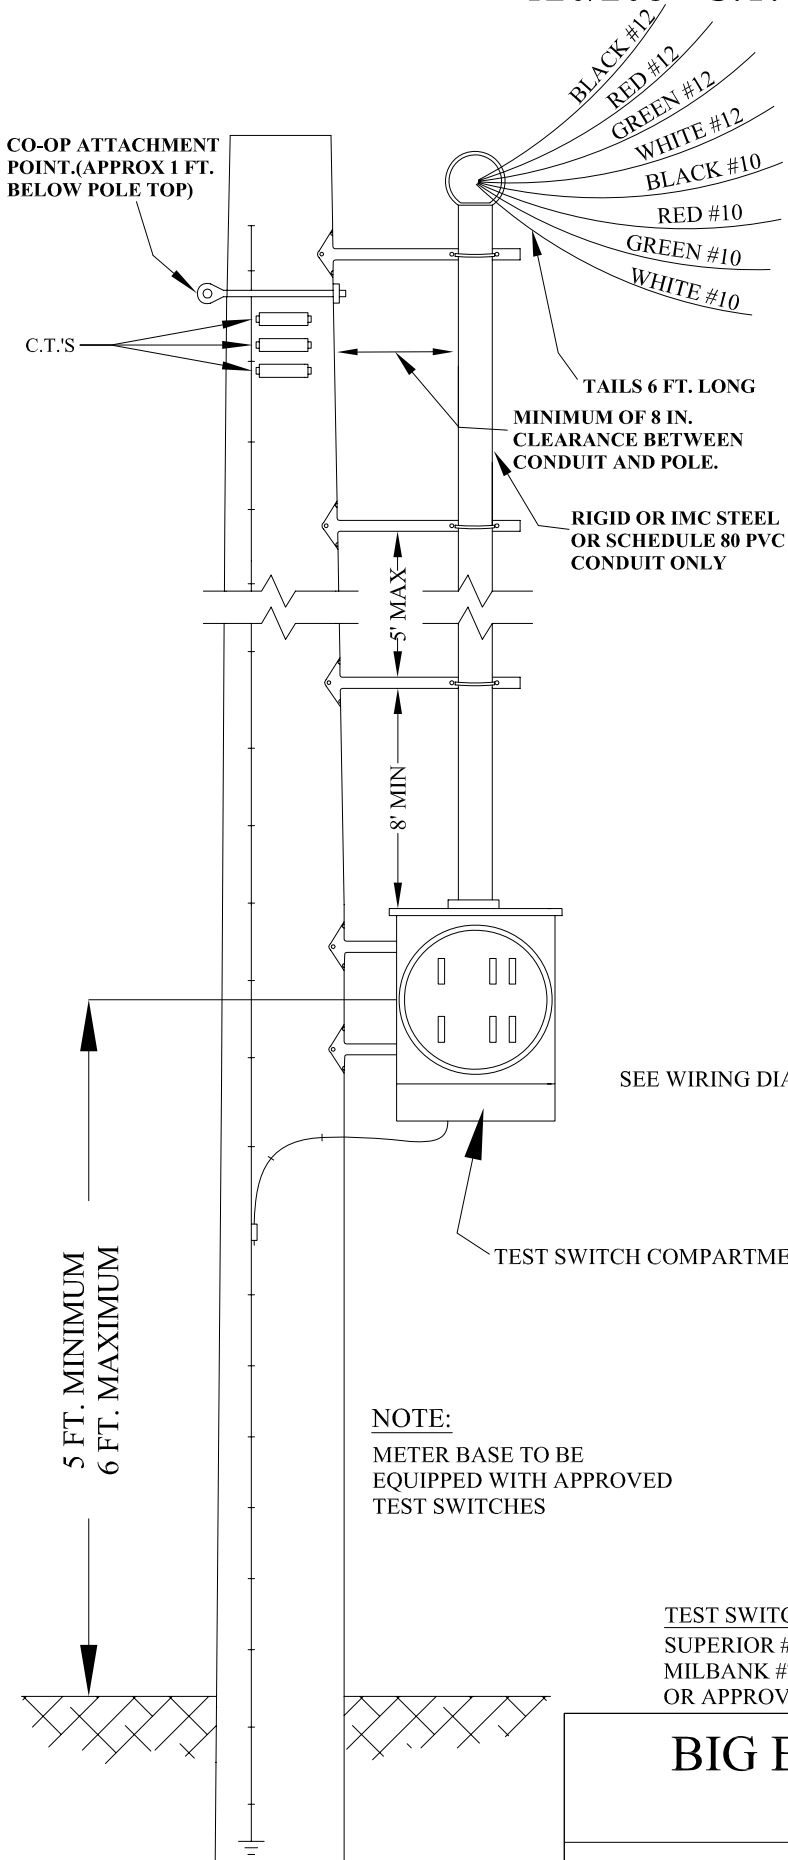

- NOTES:**
1. POLE, SERVICE TO POLE, METER, GROUND WIRE AND CURRENT TRANSFORMERS FURNISHED BY B.B.E.C.
 2. C.T. METERING TO BE USED FOR LOADS OVER 70 KW.
 3. ALL CONDUITS AND METERING TO BE MOUNTED ON STAND-OFF BRACKETS A MINIMUM OF 8 IN. FROM POLE
 4. CONDUIT LENGTH AS REQUIRED TO PLACE WEATHER HEAD BETWEEN CO-OP ATTACHMENT POINT AND POLE TOP. TYPICAL LENGTHS:
14 FT. FOR 25 FT. POLE
18.5 FT. FOR 30 FT. POLE
23 FT. FOR 35 FT. POLE
 5. CONDUIT SHALL BE RIGID OR IMC STEEL OR SCHEDULE 80 PVC ONLY.
 6. DEPENDENT ON YOUR SERVICE INSTALLATION, A MAIN BREAKER MAY BE REQUIRED. CONTACT AN ELECTRICIAN OR STATE L & I PRIOR TO INSTALLING YOUR METERING EQUIPMENT.
 7. METER BASE TO BE C.T. RATED AND EQUIPPED WITH TEST SWITCHES

WIRING DIAGRAM

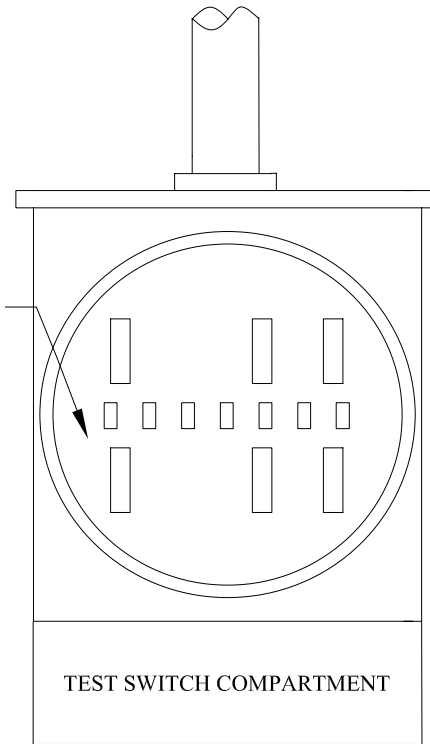

NOTE:
METER BASE TO BE EQUIPPED WITH APPROVED TEST SWITCHES

TEST SWITCH, 10 POLE:
SUPERIOR #1058F,
MILBANK #TS10-0109,
OR APPROVED EQUIVALENT

METER BASE, 13 JAW:
SUPERIOR #11523M,
C.A.W. #121413,
OR APPROVED EQUIVALENT

BIG BEND ELECTRIC COOP, INC.
RITZVILLE, WA

DIAGRAM H

Drawn By:	J.R.L.	Date:	3/24/09
Approved By:	C.A.C.	Date:	4/27/09