


METER / BREAKER COMBINATION UNDERGROUND SERVICE - SINGLE PHASE

120/240 VOLTS - SELF CONTAINED COMMERCIAL APPLICATION

METER HEIGHT REQUIREMENTS FROM CENTER OF METER TO GROUND LEVEL

MAXIMUM HEIGHT = 6 FEET
MINIMUM HEIGHT = 4 FEET OR LOWER IF ACCEPTABLE
TO STATE ELECTRICAL INSPECTOR

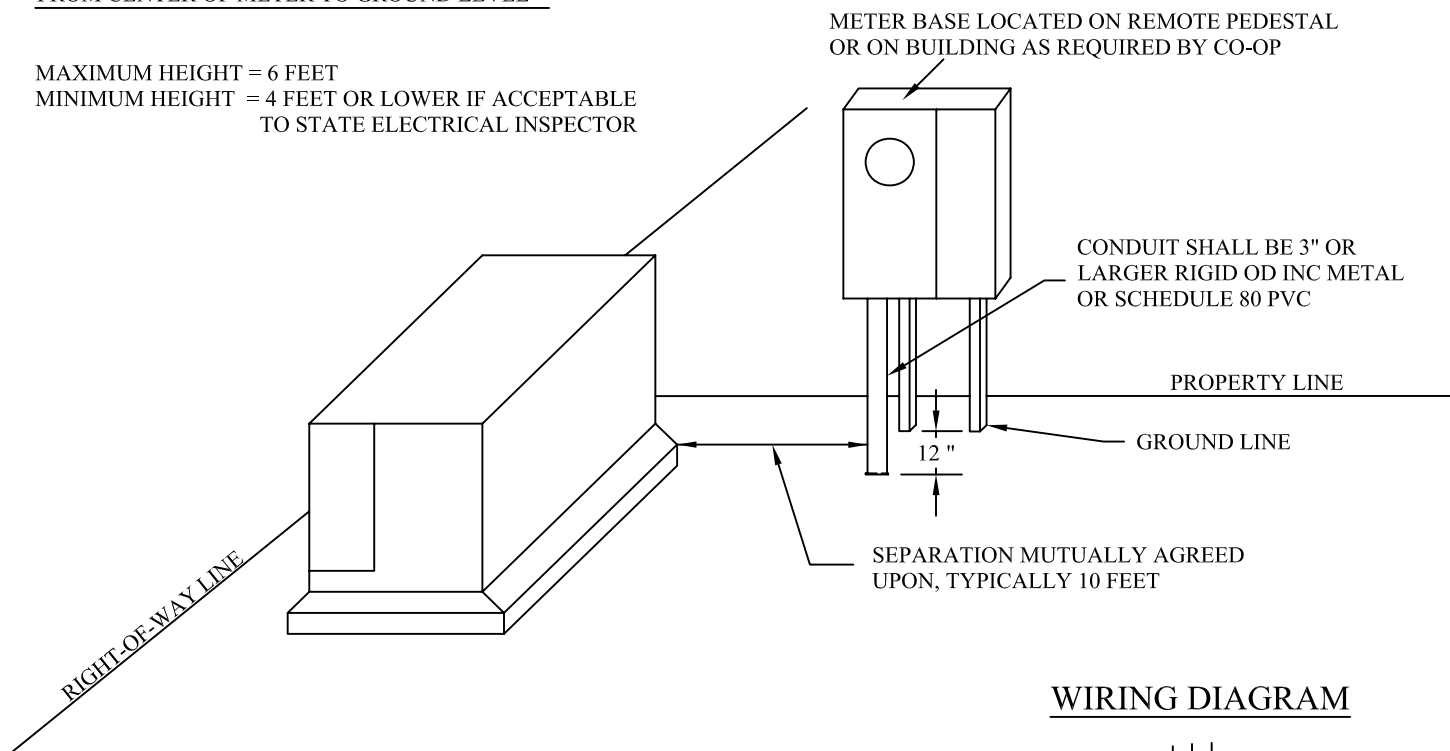


NOTE :
FUSES OR CIRCUIT BREAKER(S) MAY BE REQUIRED,
CONSULT WITH CO-OP ENGINEERING DEPARTMENT.

REQUIREMENTS:

1. METER LOOP MUST BE LOCATED IN A MUTUALLY AGREEABLE LOCATION ALONG PROPERTY LINE, ADJACENT TO CO-OP FACILITIES, OR ON BUILDING AS REQUIRED BY CO-OP.
2. METER LOOP WILL INCLUDE PROVISIONS FOR THE INSTALLATION OF A SELF CONTAINED METER, METER SUPPLIED BY THE CO-OP. C.T. INSTALLATIONS REQUIRE PERMISSION OF THE CO-OP'S ENGINEERING DEPT. PRIOR TO INSTALLATION OF THE METER LOOP.
3. CO-OP WIRE SHALL ENTER METERING CABINET IN 3" OR LARGER RIGID OR IMC METAL OR SCHEDULE 80 PVC CONDUIT ONLY.
4. WAC 296-46-160 REQUIRES THE ELECTRICIAN TO CONTACT THE CO-OP PRIOR TO THE INSTALLATION OF THE METER LOOP.

WIRING DIAGRAM

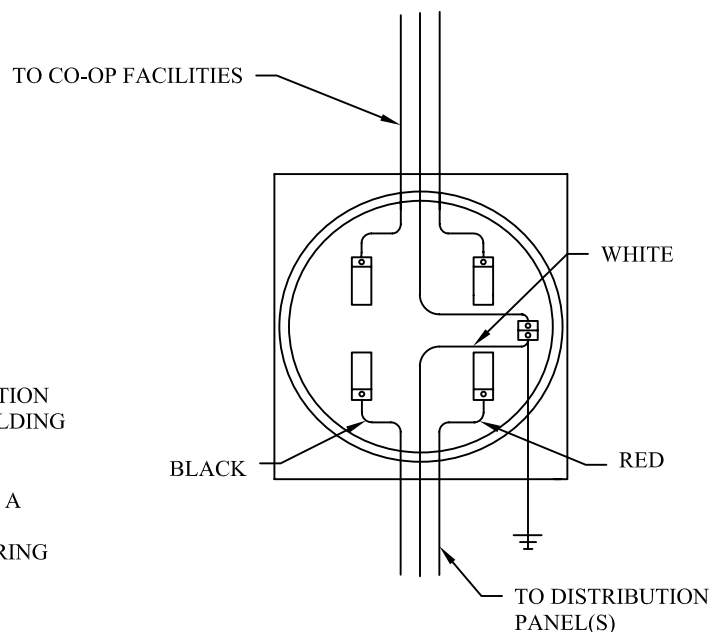

METER BASE, 4 JAW

CIRCLE A-W CATALOG NO. U404-2MCC (AIC 10K)
OR APPROVED EQUIVALENT

**BIG BEND ELECTRIC COOP, INC.
RITZVILLE, WA**

Drawn By: M. R. B.

Date: 12/14/01 REVISED 4/14/04

Approved By: D. R. B.

Date: 4/14/04

DIAGRAM N1