


HOUSE "PERISCOPE" SERVICE - SINGLE PHASE


120/240 VOLTS SELF CONTAINED

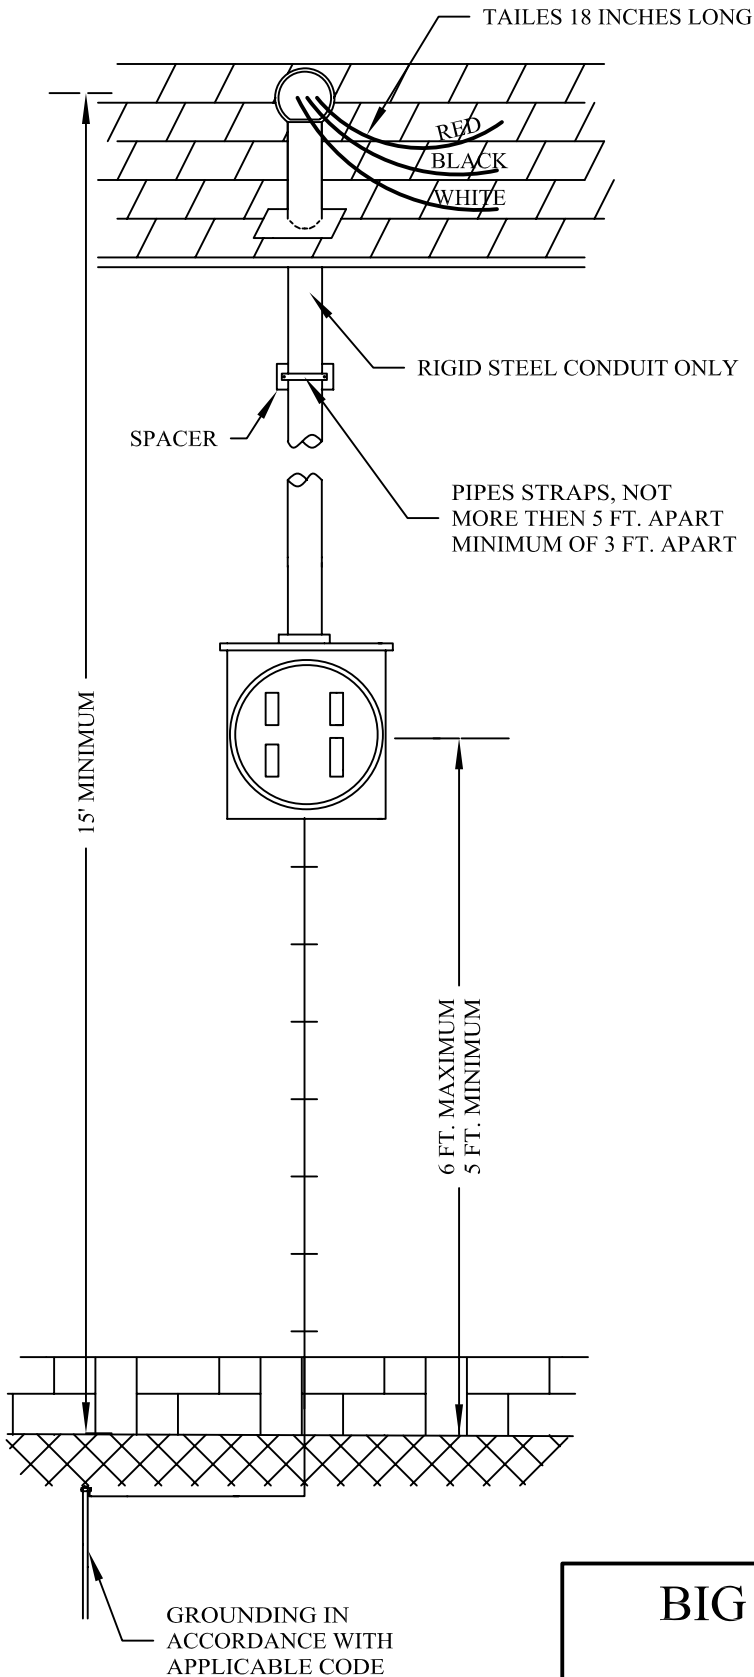

NOTES:

1. MAXIMUM RATING 200 AMPS, APPROVAL REQUIRED FOR 320 AMP.
2. C.T. INSTALLATIONS REQUIRE PERMISSION BY THE CO-OP'S ENGINEERING DEPARTMENT PRIOR TO THE INSTALLATION OF THE METER LOOP.
3. CONDUIT SHALL BE RIGID STEEL ONLY.
4. METER BASE SHALL BE LOCATED ON THE SIDE OF THE BUILDING FACING THE COOPERATIVES FACILITIES.
5. DEPENDENT UPON YOUR SERVICE INSTALLATION, A MAIN BREAKER MAY BE REQUIRED. CONTACT ENGINEERING PRIOR TO INSTALLING YOUR METERING EQUIPMENT.
6. MAST CLAMP AND INSULATOR TO BE SUPPLIED AND INSTALLED BY THE CO-OP.

WIRING DIAGRAM

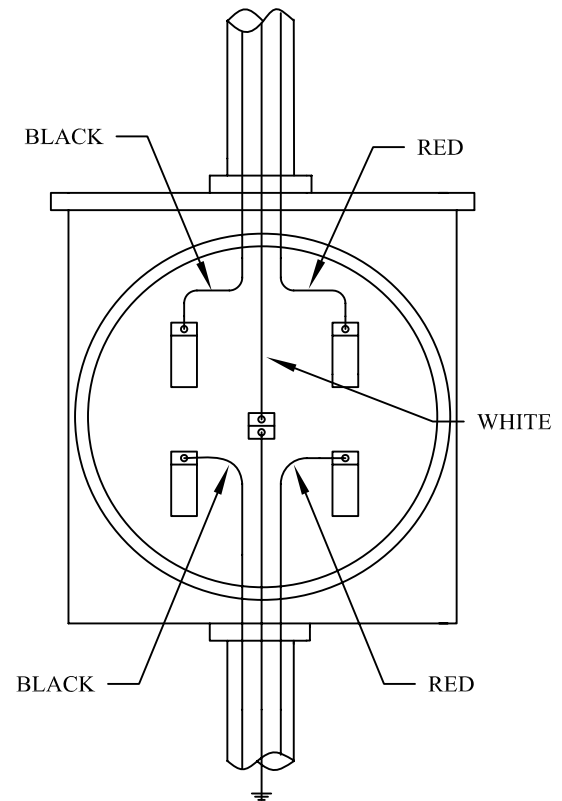

BIG BEND ELECTRIC COOP, INC.
RITZVILLE, WA

Drawn By: M. R. B.

Date: 12 / 14 / 01 Revised: 4/14/04

Approved By: D. R. B.

Date: 04 / 14 / 04

DIAGRAM P