


HOUSE SERVICE, UNDERGROUND - SINGLE PHASE


120/240 VOLTS SELF CONTAINED

NOTES:

1. MAXIMUM RATING 200 AMPS, APPROVAL REQUIRED FOR 320 AMP.
2. CO-OP WIRE SHALL ENTER METERING CABINET IN 3" OR LARGER RIGID OR IMC METAL OR SCHEDULE 80 PVC CONDUIT ONLY.
3. METER BASE SHALL BE LOCATED ON A SIDE OF THE BUILDING FACING THE COOPERATIVES FACILITIES.
4. METER LOOP MUST BE EQUIPPED WITH FUSES OR CIRCUIT BREAKER(S).
5. C.T. INSTALLATIONS REQUIRE PERMISSION BY THE CO-OP'S ENGINEERING DEPARTMENT PRIOR TO THE INSTALLATION OF THE METER LOOP.

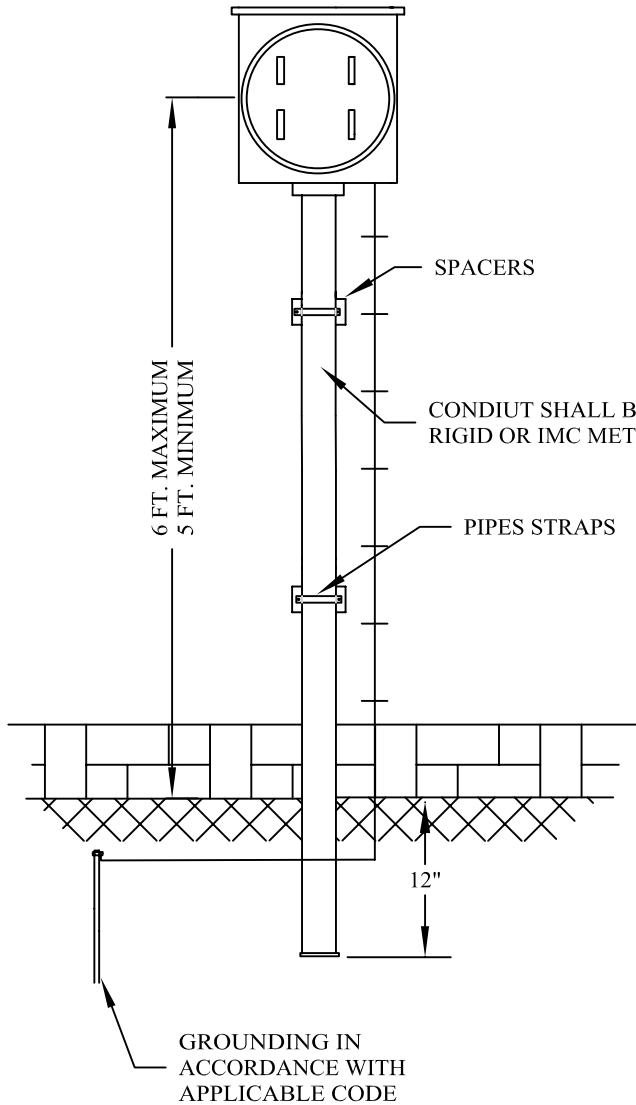

WIRING DIAGRAM

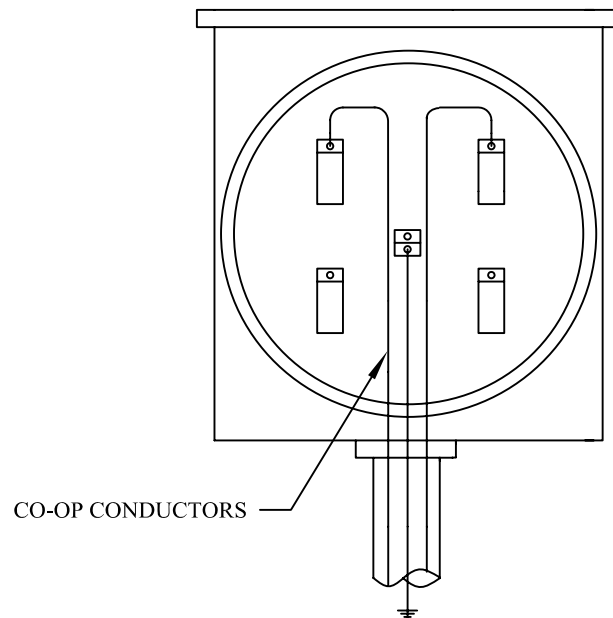

BIG BEND ELECTRIC COOP, INC.
RITZVILLE, WA

Drawn By: M. R. B.

Date: 12/13/01 REVISED: 4/14/04

Approved By: D. R. B.

Date: 4/14/04

DIAGRAM R